

	Technické návody na lúčové siete HVDC.	TNI CLC/TR 50609 33 0130
--	---	--

Táto technická normalizačná informácia obsahuje anglickú verziu CLC/TR 50609:2014.
This Technical standard information includes the English version of CLC/TR 50609:2014.

Táto technická normalizačná informácia bola oznámená vo Vestníku ÚNMS SR č. 06/14

TECHNICAL REPORT
RAPPORT TECHNIQUE
TECHNISCHER BERICHT

CLC/TR 50609

February 2014

ICS 29.240.01

English version

Technical Guidelines for Radial HVDC Networks

Directives techniques pour les réseaux
HVDC radiaux

Technischer Leitfaden für radiale HGÜ-
Netze

This Technical Report was approved by CENELEC on 2013-12-09.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

CENELEC

European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Avenue Marnix 17, B - 1000 Brussels

Contents

Page

Foreword	7
0 Introduction	8
0.1 The European HVDC Grid Study Group	8
0.2 Technology	9
0.2.1 Converters	9
0.2.2 DC Circuit	9
0.2.3 Technological Focus of the European HVDC Grid Study Group	10
1 Scope	12
2 Terminology and abbreviations	12
2.1 General	12
2.2 Terminology and abbreviations for HVDC Grid Systems used in this report	12
2.3 Proposed Terminology by the Study Group	13
3 Typical Applications of HVDC Grids	14
3.1 The Development of HVDC Grid Systems	14
3.2 Planning Criteria for Topologies	15
3.2.1 General	15
3.2.2 Power Transfer Requirements	16
3.2.3 Reliability	17
3.2.4 Losses	19
3.2.5 Future Expansions	21
3.3 Technical Requirements	21
3.3.1 General	21
3.3.2 Converter Functionality	22

3.3.3	Start/stop Behaviour of Individual Converter Stations	23
3.3.4	Network Behaviour during Faults	24
3.3.5	DC-AC Interface Requirements	25
3.3.6	The Role of Communication	26
3.4	Typical Applications – Relevant Topologies	27
3.4.1	General.....	27
3.4.2	Radial Topology	27
3.4.3	Meshed Topology	29
3.4.4	HVDC Grid Systems Connecting Offshore Wind Power Plants	29
3.4.5	Connection of a wind power plant to an existing HVDC VSC link	30
4	Principles of DC Load Flow.....	31
4.1	General	31
4.2	Structure of Load Flow Controls	31
4.2.1	General.....	31
4.2.2	Converter Station Controller	31
4.2.3	HVDC Grid Controller	32
4.3	Converter Station Control Functions	34
4.3.1	General.....	34
4.3.2	DC Voltage (U_{DC}) Stations	34
4.3.3	Active Power (P_{DC}) and Frequency (f) Controlling Stations	34
4.4	Paralleling Transmission Systems	35
4.4.1	General.....	35
4.4.2	Paralleling on AC and DC side	35
4.4.3	Paralleling on the AC side	35
4.4.4	Steady-State Loadflow in Hybrid AC/DC Networks.....	36

4.5	Load Flow Control	38
4.5.1	DC Voltage Operating Range.....	38
4.5.2	Static and Dynamic System Stability.....	39
4.5.3	Step response	39
4.6	HVDC Grid Control Concepts.....	40
4.6.1	General.....	40
4.6.2	Voltage-Power Droop Together with Dead Band.....	45
4.6.3	Voltage-Current Droop	48
4.6.4	Voltage-Power Droop — Control of the HVDC Grid Voltage	54
4.7	Benchmark Simulations of Control Concepts.....	57
4.7.1	Case Study	57
4.7.2	Results	58
4.7.3	Conclusions	60
4.7.4	Interoperability	61
5	Short-Circuit Currents and Earthing	61
5.1	General	61
5.2	Calculation of Short-Circuit Currents in HVDC Grid Systems.....	61
5.3	Network Topologies and their Influence on Short-Circuit Currents	63
5.3.1	Influence of DC Network Structure	63
5.3.2	Influence of Line Discharge.....	66
5.3.3	Influence of Capacitors	67
5.3.4	Contribution of Converter Stations.....	69
5.3.5	Methods of Earthing	72
5.4	Secondary Conditions for Calculating the Maximum/Minimum Short-Circuit Current.....	73
5.5	Calculation of the Total Short-Circuit Current (Super Position Method).....	74

5.6	Reduction of Short-Circuit Currents	75
6	Principles of HVDC Grid Protection	76
6.1	General	76
6.2	HVDC Grid System	77
6.3	AC/DC Converter	78
6.3.1	General.....	78
6.3.2	DC System	79
6.3.3	HVDC Switchyard.....	80
6.3.4	HVDC System without Fast Dynamic Isolation.....	80
6.3.5	HVDC System with Fast Dynamic Isolation	80
6.4	DC Protection.....	81
6.4.1	General.....	81
6.4.2	DC Converter Protections	81
6.4.3	Protective Shut Down of a Converter	83
6.4.4	DC System Protections	84
6.4.5	DC Equipment Protections	84
6.5	Clearance of Earth Faults	84
6.5.1	Clearance of a DC Pole-to-Earth Fault.....	84
6.5.2	Clearance of a Pole-to Pole Short Circuit	85
6.5.3	Clearance of a Converter side AC Phase-to-Earth Fault	85
7	Functional Specifications.....	85
7.1	General	85
7.2	AC/DC Converter Stations	86
7.2.1	DC System Characteristics.....	86
7.2.2	Operational Modes.....	89
7.2.3	Testing and Commissioning.....	95

7.3	HVDC breaker	96
7.3.1	System Requirements	96
7.3.2	System Functions	96
7.3.3	Interfaces and Overall Architecture	96
7.3.4	Service Requirements	96
7.3.5	Technical System Requirements	96
Annex A	(informative) HVDC – Grid Control Study	99
Annex B	(informative) Fault Behaviour of Full Bridge Type MMC	106
B.1	Introduction	106
B.2	Test Results	106
B.3	DC to DC Terminal Faults	106
B.4	DC Terminal to Ground Faults	107
B.5	Conclusion	107
Bibliography		119

Foreword

This document (CLC/TR 50609:2014) has been prepared by CLC/TC 8X “System aspects of electrical energy supply”.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC [and/or CEN] shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a mandate given to CENELEC by the European Commission and the European Free Trade Association.

This document was already sent out within CLC/TC 8X for comments and the comments received were discussed within CLC/TC 8X/WG 06 and were incorporated in the current document as far as appropriate.

0 Introduction

0.1 The European HVDC Grid Study Group

Existing power systems in Europe have been developing for more than 100 years to transmit the power, generated mainly by fossil and nuclear power plants to the loads. Climate change, limited fossil resources and concerns over the security of nuclear power are drivers for an increased utilization of renewable sources, such as wind and solar, to realize a sustainable energy supply. According to the geological conditions, the location of large scale renewable energy sources is different to the location of existing conventional power plants and imposes new challenges for the electric power transmission networks, such as extended transmission capacity requirements over long distances, load flow control and system stability. The excellent bulk power long distance transmission capabilities, low transmission losses and precise power flow control make High Voltage Direct Current (HVDC) the key transmission technology for mastering these challenges, in particular for connection of offshore wind power plants to the onshore transmission systems.

While the power system reinforcement is already underway by a number of new point-to-point HVDC interconnections, the advantages offered by multiterminal HVDC systems and HVDC grids become more and more attractive. Examples are grid access projects connecting various wind power plants or combining wind plants with point-to-point transmission, e.g. in the North and Baltic Seas. Multiterminal projects are already in execution and there is planning for pan-European HVDC grids. In this document, multiterminal HVDC systems and HVDC grids are referred to as HVDC Grid Systems.

To become reality, HVDC Grid Systems need, in addition to the necessary political framework for cross country system design, construction and operation, competitive supply chains of equipment capable of operating together as an integrated system. This marks a significant change in the HVDC technology market. While today - with very few exceptions – a HVDC transmission system has been provided by a single manufacturer, future HVDC Grid Systems will be built step by step composed of converters and HVDC substations supplied by different manufacturers. Interoperability will thus become a fundamental requirement for future HVDC technology.

Common understanding of basic operating and design principles of HVDC Grid Systems is seen as a first step towards multi vendor systems, as it will help the development for the next round of European multiterminal projects. Furthermore, it will prepare the ground for more detailed standardization work.

Based on an initiative by the DKE German Commission for Electrical, Electronic and Information Technologies, the European HVDC Grid Study Group has been founded in September 2010 to develop “Technical Guidelines for first HVDC Grids”. The Study Group has the following objectives:

- to describe basic principles of HVDC grids with the focus on near term applications;
- to develop functional specifications of the main equipment and HVDC grid controllers;
- to develop “New Work Item Proposals” to be offered to CENELEC for starting standardization work.

CIGRÉ SC B4, CENELEC TC8x and ENTSO-E and “Friends of the Supergrid” are involved at an informative level with the results of the work.

Members affiliated with the following companies and organizations have been actively contributing to the results of the Study Group achieved so far: 50 Hz Transmission, ABB, ALSTOM, Amprion, DKE,

TransnetBW, Energinet.dk, ETH Zurich, National Grid, Nexans, Prysmian, SEK, Siemens, TenneT and TU Darmstadt.

As a starting point the Study Group has been investigating typical applications and performance requirements of HVDC Grid Systems. This information helps elaborating the basic principles of HVDC networks, which are described in the following clauses:

- Clause 3, Typical Applications of HVDC Grids;
- Clause 4, Principles of DC Load Flow;
- Clause 5, Short-Circuit Currents and Earthing;
- Clause 6, Principles of HVDC Grid Protection.

From the technical principles described, functional specifications for the main equipment of HVDC networks are derived and summarized in Clause 7.

0.2 Technology

0.2.1 Converters

HVDC transmission started more than 60 years ago. Today, the installed HVDC transmission capacity exceeds 200 GW worldwide. The vast majority of the existing HVDC links are based on so-called Line-Commutated-Converters (LCC). LCC today are built from Thyristors. The power exchange of such converters is determined by controlling the point-on-wave of valve turn-on, while the turn-off occurs due to the natural zero crossing of valve current forced by the AC network voltage. That is why LCC rely on relatively strong AC systems to provide conversion from AC to DC and vice versa.

With so-called Voltage Sourced Converters (VSC), a different type of converters has been introduced to HVDC transmission slightly more than a decade ago. VSCs today utilize Insulated Gate Bipolar Transistors (IGBT) as the main switching elements. IGBTs have controlled turn-on as well as turn-off capability making the VSCs capable of operating under weak AC system conditions or supplying power systems where there is no other voltage source, also referred to as passive networks.

The evolution of VSC transmission was started with so-called Two-Level converters at the end of the 1990s and has commenced to Three Level Converters and further to Modular Multilevel Converters (MMC) which have made their break-through in the mid to late 2000s. All MMC type converters apply the same principle of connecting a number of identical converter building blocks in series. However, at the present time there are basically two types of such building blocks: referred to as Half-Bridge (HB) and Full-Bridge (FB) modules.

Other converter equipment which have been proposed for HVDC Grid applications, such as DC/DC converters, load flow controllers, etc. are not discussed in this document.

0.2.2 DC Circuit

Similar to AC networks, HVDC transmission systems can be distinguished by their network topologies as radial and/or meshed networks and with respect to earthing in effectively grounded and isolated systems. Both aspects influence the design criteria and the behaviour of the HVDC system.

– Radial and Meshed Topologies:

In radial systems, there is not more than one connection between two arbitrary nodes of the network. The DC voltages of the converter stations connected to each end of a line solely determine the power flow through that line, for example in Figure 1-1, station C is radially connected with station D.

In meshed systems, at least two converter stations have more than one connecting path. Without any additional measures the current through a line will then be determined by the DC voltages of the converter stations as well as the resistances of the parallel connections. In Figure 1-1, the DC circuit connecting stations A, B and C forms a meshed system while C and D is a radial connection. A HVDC Grid System having a meshed topology can be operated as a radial system if parallel connections are opened by disconnectors or breakers.

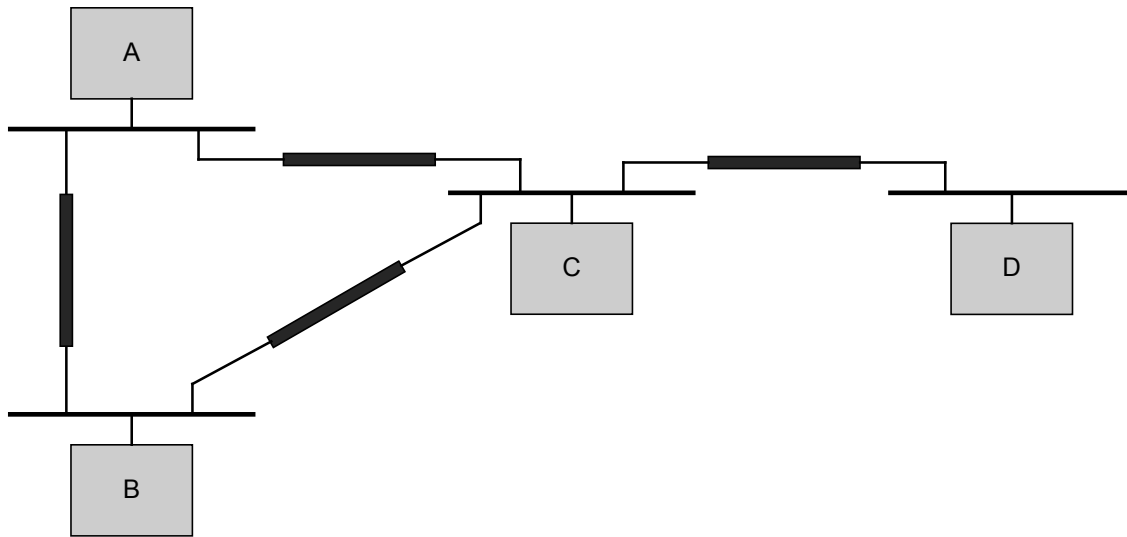


Figure 1-1 — Example of an HVDC Grid System having a meshed and radial structure

– Earthing:

DC circuits can be effectively grounded if one DC pole is connected to earth through a low ohmic branch. Such systems are also referred to as asymmetrical Monopoles or just “Monopoles”. Two Monopoles of opposite DC voltage polarity are often combined into so-called bipolar systems or just “Bipoles”.

Isolated DC circuits do not have a low ohmic connection to ground on the DC side. These configurations are also referred to as “Symmetrical Monopoles”.

0.2.3 Technological Focus of the European HVDC Grid Study Group

Various technologies are available for building HVDC Grid Systems. Some of them have already been used in commercial projects; others are in the demonstration phase or are in an early stage of discussion. This applies to the converter technology as well as the topologies of connecting them into a HVDC Grid System.

Serving the near term applications, the Study Group decided to focus its scope of work on radial HVDC network structures as well as pure VSC based solutions. Both grounded and ungrounded DC circuits are considered.

The integration of HVDC Grid Systems is seen as an important part of developing future electric power systems. The Study Group bases its work on typical requirements applied to state of the art HVDC converter stations today and investigates aspects that are specifically related to the design and operation of converter stations and DC circuits. The requirements from the AC systems as known today are included. Secondary effects associated with changing the AC systems, e.g. the replacement of rotating machines by power electronic devices, are not within the scope of the Study Group.

The Study Group report summarizes the selected results of work and gives recommendations for the next steps towards preparing the ground for standardization of HVDC multiterminal systems and HVDC Grid Systems.

The interface requirements and functional specifications given in this document are intended to support the specification and purchase of multi vendor multiterminal HVDC Grid Systems.

1 Scope

This Technical Report applies to HVDC Systems having more than two converter stations connected to a common DC network, also referred to as HVDC Grid Systems. Serving the near term applications, this report describes radial HVDC network structures as well as pure VSC based solutions. Both grounded and ungrounded DC circuits are considered.

Based on typical requirements applied to state of the art HVDC converter stations today this report addresses aspects that are specifically related to the design and operation of converter stations and DC circuits in HVDC Grid Systems. The requirements from the AC systems as known today are included. Secondary effects associated with changing the AC systems, e.g. the replacement of rotating machines by power electronic devices, are not within the scope of the present report.

The report summarizes applications and concepts of HVDC Grid Systems with the purpose of preparing the ground for standardization of such systems.

The interface requirements and functional specifications given in this document are intended to support the specification and purchase of multi-vendor multiterminal HVDC Grid Systems.