

STN	Vysokonapäťové spínacie a riadiace zariadenia. Časť 202: Blokové transformovne vysokého/nízkeho napätia. Oprava AC2	STN EN 62271-202/AC2 35 4220
------------	--	--

Táto norma obsahuje anglickú verziu európskej normy.
This standard includes the English version of the European Standard.

Táto norma bola oznámená vo Vestníku ÚNMS SR č. 09/16

Text opravy je v dokumente IEC.

Obsahuje: EN 62271-202:2014/AC Apr.:2015, IEC 62271-202:2014/COR1:2015

123484

INTERNATIONAL ELECTROTECHNICAL COMMISSION
COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

IEC 62271-202
Edition 2.0 2014-03

IEC 62271-202
Édition 2.0 2014-03

High-voltage switchgear and controlgear –

Appareillage à haute tension –

Part 202: High-voltage/low-voltage prefabricated
substation

Partie 202: Postes préfabriqués haute
tension/basse tension


CORRIGENDUM 1

Corrections to the French version appear after the English text.

Les corrections à la version française sont données après le texte anglais.

Figure AA.6 – Selection of tests on high voltage interconnections for class IAC-A

Replace the existing figure by the following new figure:

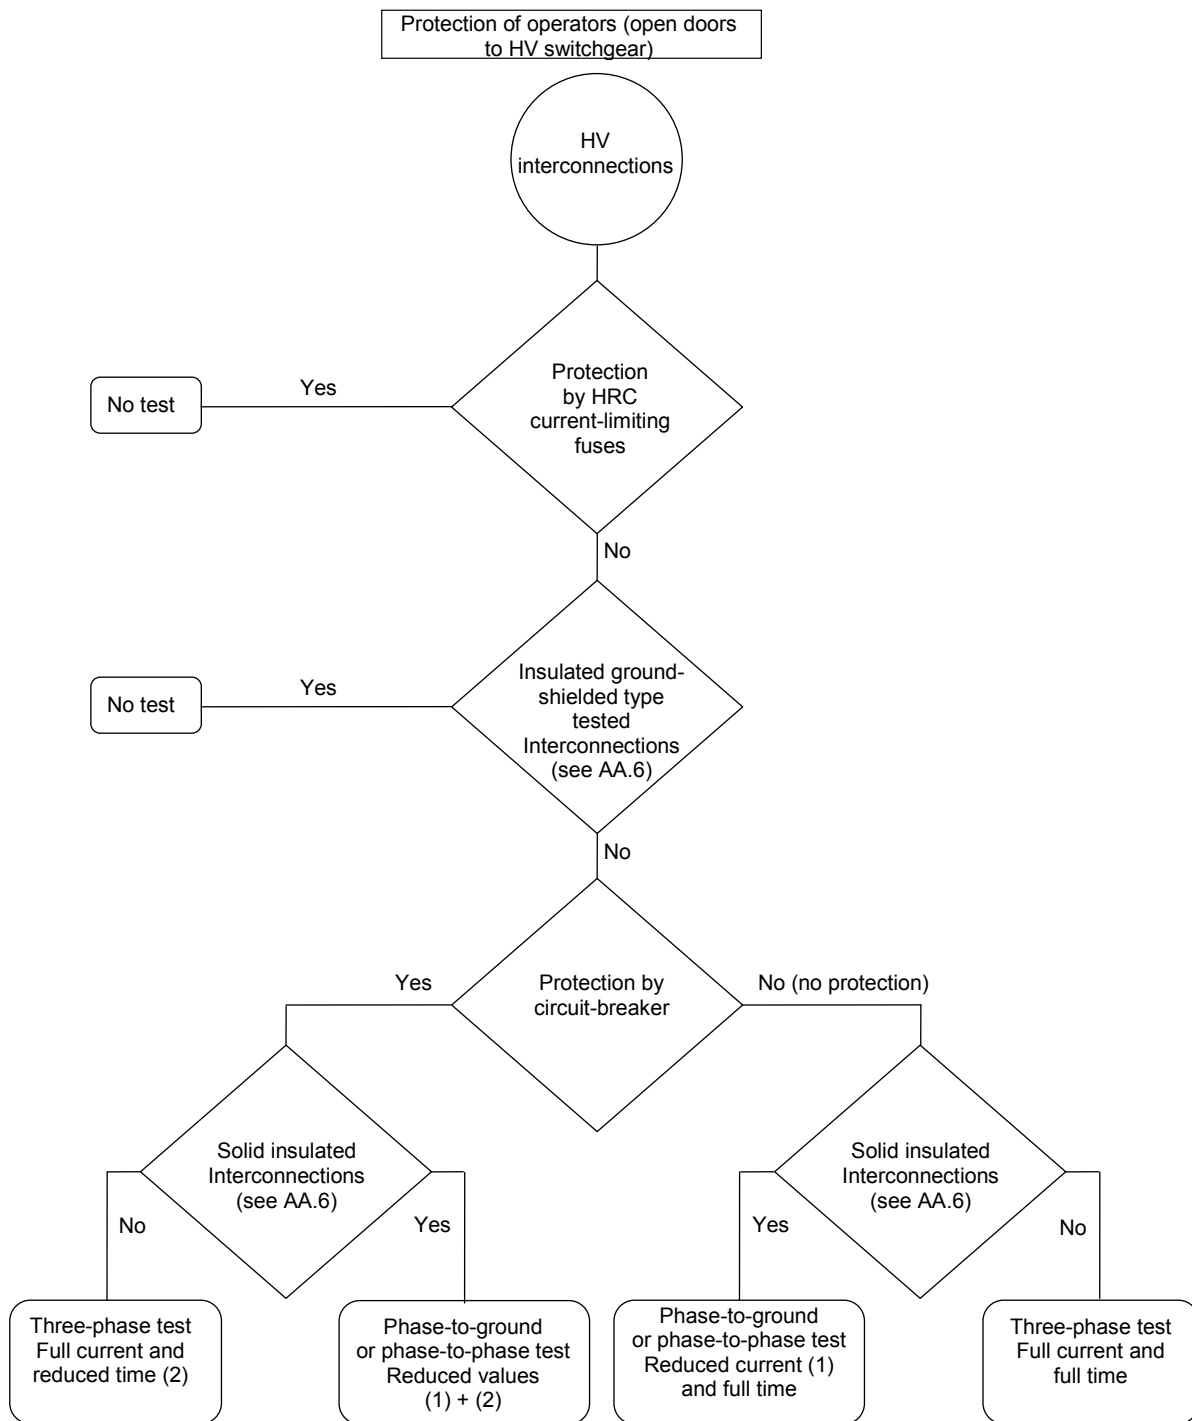

(1) IEC 62271-200:2011.

* For phase to ground test the current value to be stated by the manufacturer.


* For phase to phase test the current will be 87 % of the rated short-time withstand current.

(2) The time may be stated by the manufacturers, taking into account the time-setting of the protection.

Figure AA.6 – Selection of tests on high voltage interconnections for class IAC-A

Figure AA.7 – Selection of tests on high voltage interconnections for class IAC-B

Replace the existing figure by the following new figure:

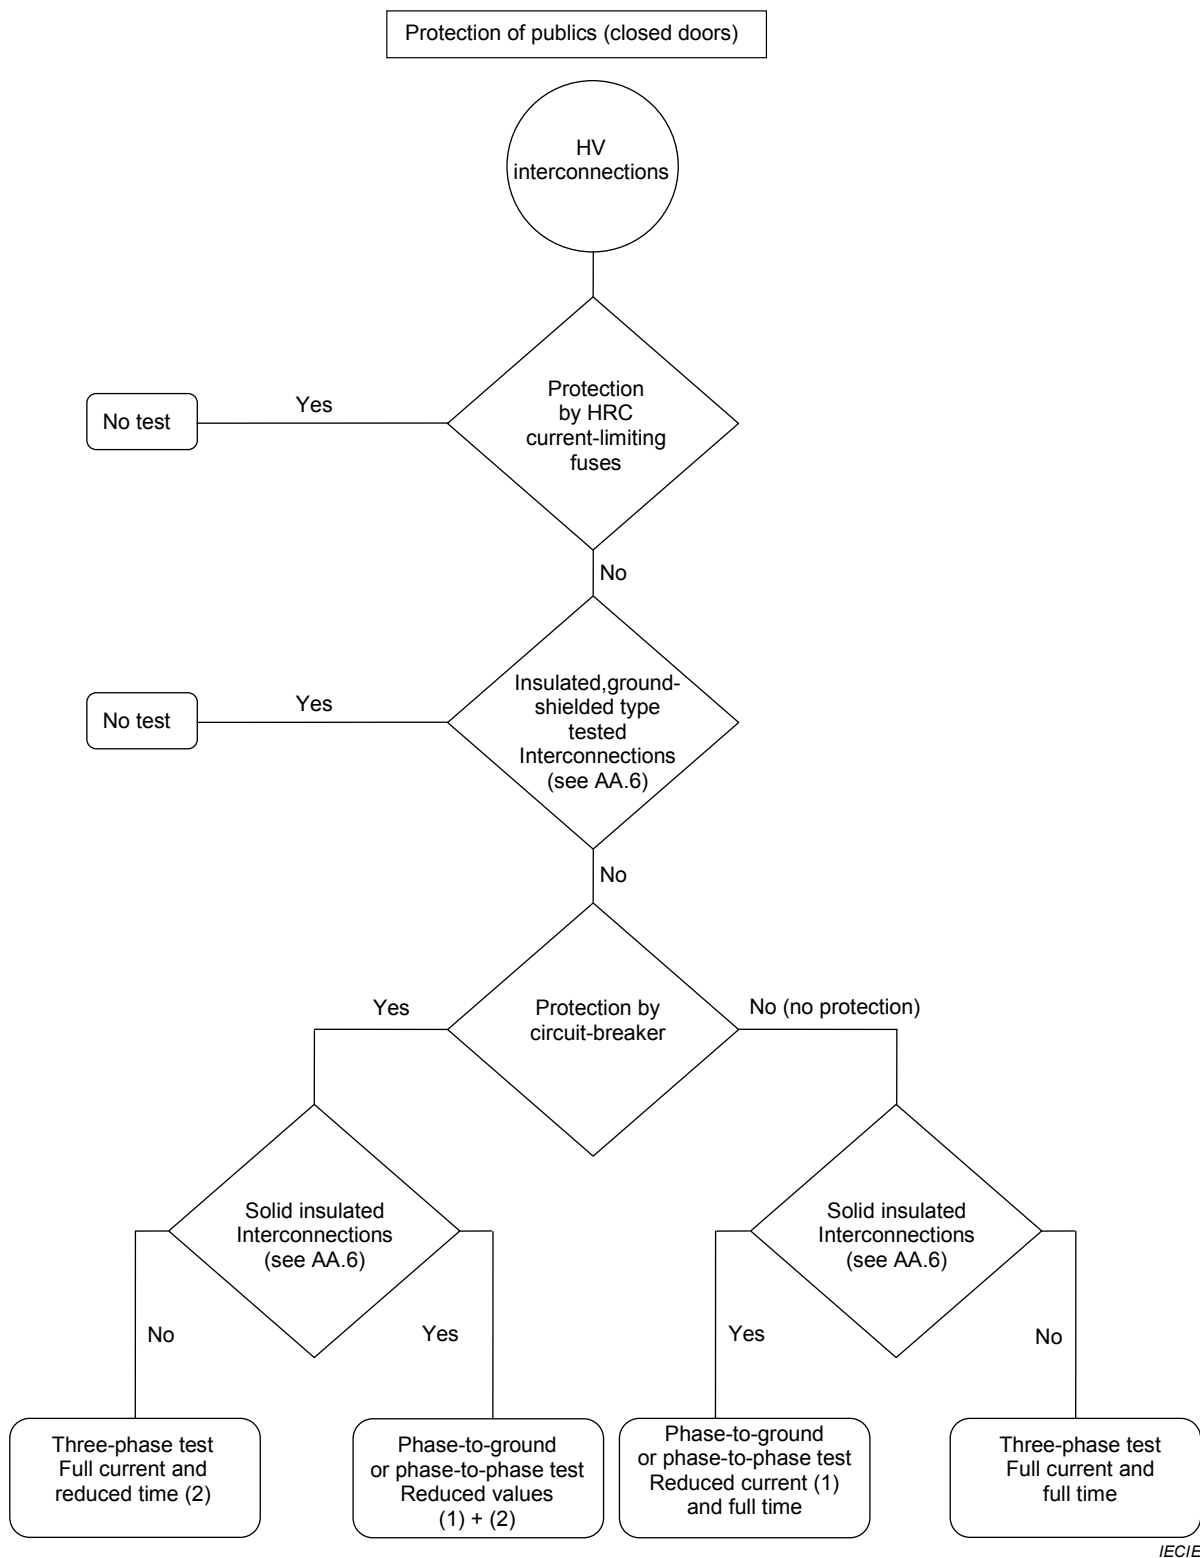

IECIE

(1) Applicability of phase to ground or phase to phase test according to the criteria in AA.5.2.1 of IEC 62271-200:2011.

* For phase to ground test the current value to be stated by the manufacturer.

* For phase to phase test the current will be 87 % of the rated short-time withstand current.

(2) The time may be stated by the manufacturers, taking into account the time-setting of the protection.

Figure AA.7 – Selection of tests on high voltage interconnections for class IAC-B