

|                  |  |  |
|------------------|--|--|
| <b>STN<br/>P</b> | <b>Informačné technológie</b><br><b>Zariadenia a infraštruktúry výpočtových stredísk</b><br><b>Časť 5-1: Model vyspelosti pre energetické</b><br><b>manažérstvo a environmentálnu udržateľnosť</b> | <b>STN P</b><br><b>CLC/TS 50600-5-1</b><br><br>36 7254 |
|------------------|--|--|

Information technology - Data centre facilities and infrastructures - Part 5-1: Maturity Model for Energy Management and Environmental Sustainability

Táto norma obsahuje anglickú verziu európskej normy.  
This standard includes the English version of the European Standard.

Táto norma bola oznámená vo Vestníku ÚNMS SR č. 02/22

Obsahuje: CLC/TS 50600-5-1:2021

**134460**

TECHNICAL SPECIFICATION  
SPÉCIFICATION TECHNIQUE  
TECHNISCHE SPEZIFIKATION

**CLC/TS 50600-5-1**

December 2021

---

ICS 35.020; 35.110; 35.160

English Version

**Information technology - Data centre facilities and infrastructures  
- Part 5-1: Maturity Model for Energy Management and  
Environmental Sustainability**

Technologie de l'information - Installation et infrastructures  
de centres de traitement de données - Partie 5-1 : Modèle  
de maturité pour la gestion de l'énergie et la durabilité  
environnementale

Informationstechnik - Einrichtungen und Infrastrukturen von  
Rechenzentren - Teil 5-1: Reifegradmodell für  
Energiemanagement und Umweltverträglichkeit

This Technical Specification was approved by CENELEC on 2021-11-22.

CENELEC members are required to announce the existence of this TS in the same way as for an EN and to make the TS available promptly at national level in an appropriate form. It is permissible to keep conflicting national standards in force.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

---

**CLC/TS 50600-5-1:2021 (E)**

| <b>Contents</b>   | <b>Page</b> |
|---|-------------|
| European foreword .....   | 4           |
| Introduction.....   | 5           |
| 1 Scope.....  | 8           |
| 2 Normative references .....  | 8           |
| 3 Terms, definitions and abbreviations .....                                      | 8           |
| 3.1 Terms and definitions .....   | 8           |
| 3.2 Abbreviations .....   | 8           |
| 4 Concepts of data centre maturity .....  | 8           |
| 4.1 Overview .....  | 8           |
| 4.2 Basis of the maturity model .....   | 9           |
| 4.3 Progress along the Levels of the maturity model .....                         | 9           |
| 4.4 Reporting of maturity model Levels .....                                      | 10          |
| 4.5 Presentation of the maturity model .....                                      | 10          |
| 5 Practices underpinning Levels 1, 2 and 3 .....                                  | 12          |
| 5.1 General .....   | 12          |
| 5.2 Operational practices .....   | 13          |
| 5.2.1 Management: Management and operational information .....                    | 13          |
| 5.2.2 Infrastructure .....  | 13          |
| 5.2.3 ICT .....   | 14          |
| 5.2.4 Reporting .....   | 14          |
| 5.3 New build/refurbishment/upgrade practices .....                               | 15          |
| 5.3.1 Management: Management and operational information .....                    | 15          |
| 5.3.2 Infrastructure .....  | 15          |
| 6 Practices underpinning Level 4.....   | 16          |
| 6.1 General .....   | 16          |
| 6.2 Operational practices .....   | 16          |
| 6.2.1 Management: Management and operational information .....                    | 16          |
| 6.2.2 Infrastructure .....  | 17          |
| 6.2.3 ICT .....   | 17          |
| 6.2.4 Reporting: ENERGY MANAGEMENT .....  | 18          |
| 6.3 New build/refurbishment/upgrade practices .....                               | 19          |
| 6.3.1 Management: Management and operational information .....                    | 19          |
| 6.3.2 Infrastructure .....  | 19          |
| 7 Practices underpinning Level 5.....   | 19          |
| 7.1 General .....   | 19          |
| 7.2 Management .....  | 20          |
| 7.2.1 Life Cycle Assessment .....   | 20          |
| 7.2.2 DATA CENTRE MONITORING: ICT reporting - Measurement of<br>useful work ..... | 20          |
| 7.2.3 Embodied energy in devices .....  | 20          |
| 7.2.4 PUE value .....   | 20          |
| 7.2.5 Written Report .....  | 21          |
| 7.2.6 Life cycle costs for new equipment and systems .....                        | 21          |
| 7.3 INFRASTRUCTURE: Power supply and distribution.....                            | 21          |
| 7.3.1 Renewable energy.....   | 21          |
| 7.3.2 New UPS.....  | 21          |

**CLC/TS 50600-5-1:2021 (E)**

|       |  |    |
|-------|--|----|
| 7.3.3 | New intelligent power distribution units .....   | 21 |
| 7.4   | INFRASTRUCTURE: Environmental control .....  | 21 |
| 7.4.1 | CER value .....  | 21 |
| 7.4.2 | Refrigerants.....  | 21 |
| 7.4.3 | 'Capture Ready' Infrastructure .....   | 22 |
| 7.5   | ICT Compute .....  | 22 |
| 7.5.1 | CPU usage .....  | 22 |
| 7.5.2 | Idle state power value of new servers .....  | 22 |
| 7.5.3 | 80 PLUS Certified Power Supplies.....  | 22 |
| 7.5.4 | Consider circularity and the use of 2nd life hardware.....   | 22 |
| 7.6   | Reporting .....  | 22 |
| 7.6.1 | Reporting: ENERGY MANAGEMENT .....   | 22 |
| 7.6.2 | Reporting: WATER MANAGEMENT .....  | 22 |
|       | Bibliography.....  | 23 |
|       | Figure 1 — Schematic relationship between the EN 50600 series of documents .....                                       | 7  |
|       | Figure 2 — Example of the graphical representation of data centre maturity elements .....                              | 11 |
|       | Figure 3 — Example of the graphical representation of data centre maturity elements<br>including some of Level 0 ..... | 12 |

**CLC/TS 50600-5-1:2021 (E)****European foreword**

This document (CLC/TS 50600-5-1:2021) has been prepared by CLC/TC 215, “Electrotechnical aspects of telecommunication equipment”.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

This document has been prepared under a Standardization Request given to CENELEC by the European Commission and the European Free Trade Association.

Any feedback and questions on this document should be directed to the users' national committee. A complete listing of these bodies can be found on the CENELEC website.

## Introduction

The unrestricted access to internet-based information demanded by the information society has led to an exponential growth of both internet traffic and the volume of stored/retrieved data. Data centres are housing and supporting the information technology and network telecommunications equipment for data processing, data storage and data transport. They are required both by network operators (delivering those services to customer premises) and by enterprises within those customer premises.

Data centres usually provide modular, scalable and flexible facilities and infrastructures to easily accommodate the rapidly changing requirements of the market. In addition, energy consumption of data centres has become critical both from an environmental point of view (reduction of environmental footprint) and with respect to economical considerations (cost of energy) for the data centre operator.

The implementation of data centres varies in terms of:

- a) purpose (enterprise, co-location, co-hosting or network operator facilities);
- b) security level;
- c) physical size;
- d) accommodation (mobile, temporary and permanent constructions).

The needs of data centres also vary in terms of availability of service, the provision of security and the objectives for energy efficiency. These needs and objectives influence the design of data centres in terms of building construction, power distribution, environmental control, telecommunications cabling and physical security as well as the operation of the data centre. Effective management and operational information is important in order to monitor achievement of the defined needs and objectives.

Recognizing the substantial resource consumption, particularly of energy, of larger data centres, it is also important to provide tools for the assessment of that consumption both in terms of overall value and of source mix and to provide Key Performance Indicators (KPIs) to evaluate trends and drive performance improvements.

At the time of publication of this document, the EN 50600 series is designed as a framework of standards, technical specifications and technical reports covering the design, the operation and management, the key performance indicators for energy efficient operation of the data centre as well as a data centre maturity model.

The EN 50600-2 series defines the requirements for the data centre design.

The EN 50600-3 series defines the requirements for the operation and the management of the data centre.

The EN 50600-4 series defines the key performance indicators for the data centre.

The CLC/TS 50600-5 series defines the data centre maturity model requirements and recommendations.

The CLC/TR 50600-99-X Technical Reports cover recommended practices and guidance for specific topics around data centre operation and design.

This series of documents specifies requirements and recommendations to support the various parties involved in the design, planning, procurement, integration, installation, operation and maintenance of facilities and infrastructures within data centres. These parties include:

- 1) owners, operators, facility managers, ICT managers, project managers, main contractors;
- 2) consulting engineers, architects, building designers and builders, system and installation designers, auditors, test and commissioning agents;
- 3) facility and infrastructure integrators, suppliers of equipment;
- 4) installers, maintainers.

**CLC/TS 50600-5-1:2021 (E)**

At the time of publication of this document, EN 50600 series will comprise the following standards and documents:

EN 50600-1, *Information technology — Data centre facilities and infrastructures — Part 1: General concepts*

EN 50600-2-1, *Information technology — Data centre facilities and infrastructures — Part 2-1: Building construction*

EN 50600-2-2, *Information technology — Data centre facilities and infrastructures — Part 2-2: Power supply and distribution*

EN 50600-2-3, *Information technology — Data centre facilities and infrastructures — Part 2-3: Environmental control*

EN 50600-2-4, *Information technology — Data centre facilities and infrastructures — Part 2-4: Telecommunications cabling infrastructure*

EN 50600-2-5, *Information technology — Data centre facilities and infrastructures — Part 2-5: Security systems*

EN 50600-3-1, *Information technology — Data centre facilities and infrastructures — Part 3-1: Management and operational information*

EN 50600-4-1, *Information technology — Data centre facilities and infrastructures — Part 4-1: Overview of and general requirements for key performance indicators*

EN 50600-4-2, *Information technology — Data centre facilities and infrastructures — Part 4-2: Power Usage Effectiveness*

EN 50600-4-3, *Information technology — Data centre facilities and infrastructures — Part 4-3: Renewable Energy Factor*

EN 50600-4-6, *Information technology — Data centre facilities and infrastructures — Part 4-6: Energy Reuse Factor*

EN 50600-4-7, *Information technology — Data centre facilities and infrastructures — Part 4-7: Cooling Efficiency Ratio*

CLC/TS 50600-5-1, *Information technology — Data centre facilities and infrastructures — Part 5-1: Maturity Model for Energy Management and Environmental Sustainability*


CLC/TR 50600-99-1, *Information technology — Data centre facilities and infrastructures — Part 99-1: Recommended practices for energy management*

CLC/TR 50600-99-2, *Information technology — Data centre facilities and infrastructures — Part 99-2: Recommended practices for environmental sustainability*

CLC/TR 50600-99-3, *Information technology — Data centre facilities and infrastructures — Part 99-3: Guidance for the application of EN 50600 series*

The inter-relationship of the documents within the EN 50600 series is shown in Figure 1.

## CLC/TS 50600-5-1:2021 (E)

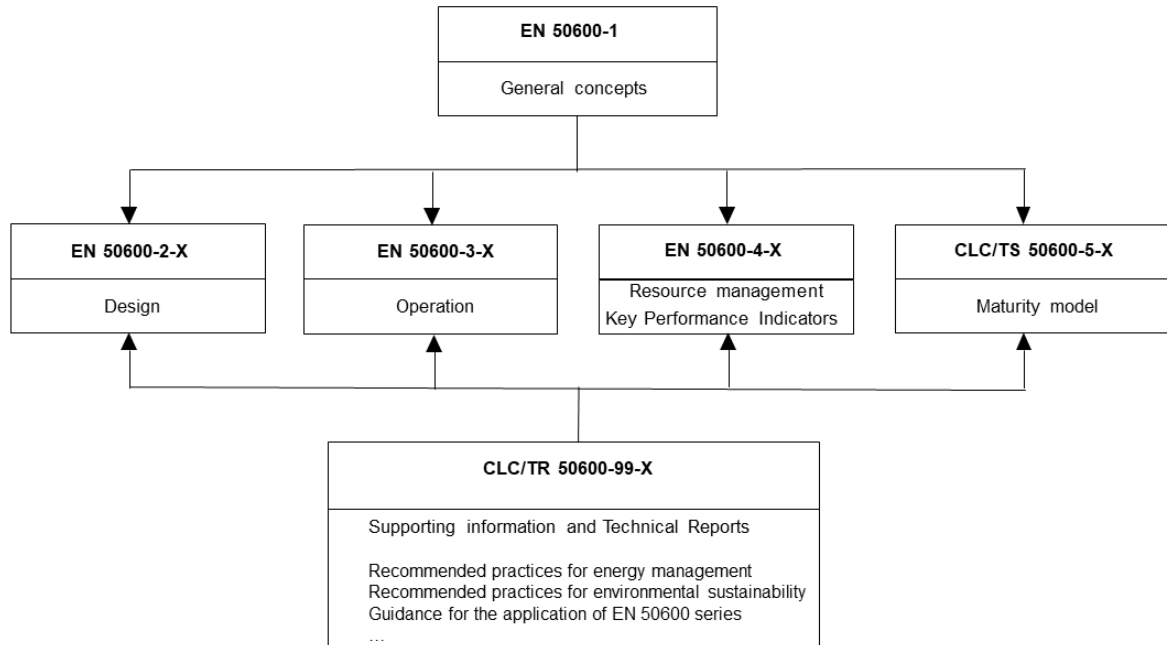

**Figure 1 — Schematic relationship between the EN 50600 series of documents**

EN 50600-2-X documents specify requirements and recommendations for particular facilities and infrastructures to support the relevant classification for “availability”, “physical security” and “energy efficiency enablement” selected from EN 50600-1.

EN 50600-3-X documents specify requirements and recommendations for data centre operations, processes and management.

EN 50600-4-X documents specify requirements and recommendations for key performance indicators (KPIs) used to assess and improve the resource usage efficiency and effectiveness, respectively, of a data centre.

This document provides a maturity model addressing the facilities, infrastructures and the information and communication technology (ICT) equipment of the data centre to enable data centre owners/operators to:

- employ a framework to baseline their data centre design and practices;
- determine the level of maturity applicable to their data centre;
- identify relevant guidance on potential areas of improvement together with the anticipated benefits to justify the resources required;
- develop an action plan to migrate to higher maturity levels.

The current document focusses on environmental impact (energy management and environmental sustainability). Other elements might be included in future documents.

NOTE The term “environmental *sustainability*” is used recognizing that well established treatments of “sustainability” feature three separate viability objectives (environmental, economic and social). For the purposes of this document, only elements of environmental viability are considered.

This document supports the wider adoption of recommended practices of other documents in the EN 50600 series and those of other recognized relevant standards in the area of energy management and environmental sustainability.



**CLC/TS 50600-5-1:2021 (E)****1 Scope**

This document provides a maturity model addressing the environmental impact (energy management and environmental sustainability) of the facilities, infrastructures and the information and communication technology (ICT) equipment accommodated by the data centre.

NOTE The term “environmental *sustainability*” is used recognizing that well established treatments of “sustainability” feature three separate viability objectives (environmental, economic and social). For the purposes of this document, only elements of environmental viability are considered.

The elements addressed include design, procurement, operation and end-of-life. The achievement of the Levels of the maturity model are based upon confirmation of the implementation of applicable practices of CLC/TR 50600-99-1 and CLC/TR 50600-99-2.

**2 Normative references**

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 50600 (series), *Information technology – Data centre facilities and infrastructures*

CLC/TR 50600-99-1:2021, *Information technology – Data centre facilities and infrastructures - Part 99-1: Recommended practices for energy management*

CLC/TR 50600-99-2:2021, *Information technology – Data centre facilities and infrastructures - Part 99-2: Recommended practices for environmental sustainability*

**koniec náhľadu – text ďalej pokračuje v platenej verzii STN**