

STN	Elektrické inštalácie nízkeho napätia Časť 5-53: Výber a stavba elektrických zariadení Spínacie a riadiace zariadenia Oprava AC	STN 33 2000-5-53/AC 33 2000
------------	--	---

Low-voltage electrical installations - Part 5-53: Selection and erection of electrical equipment - Switchgear and controlgear

Táto norma obsahuje anglickú verziu európskej normy.
This standard includes the English version of the European Standard.

Táto norma bola oznámená vo Vestníku ÚNMS SR č. 11/22

Obsahuje: HD 60364-5-53:2022/AC Aug.:2022

135789



Corrigendum to HD 60364-5-53:2022

English version

Add the following modifications to HD 60364-5-53:2022:

Insert a Table of Contents after the title page.

Correct the clause numbering throughout the document, starting with "530 Introduction", as follows:

530 Introduction**530.1 Scope****530.2 Normative references**

[...]

531 Devices for protection against electric shock by automatic disconnection of supply

[...]

532 Devices for protection against the risk of fire

[...]

533 Devices for protection against overcurrent

[...]

534 Devices for protection against transient overvoltages

[...]

535 Devices for protection against undervoltage

[...]

536 Co-ordination of electrical equipment for protection, isolation, switching and control

[...]

537 Devices for isolation and switching

[...]

538 Monitoring devices

[...]

Replace Figure 534.1 and its title with the following:

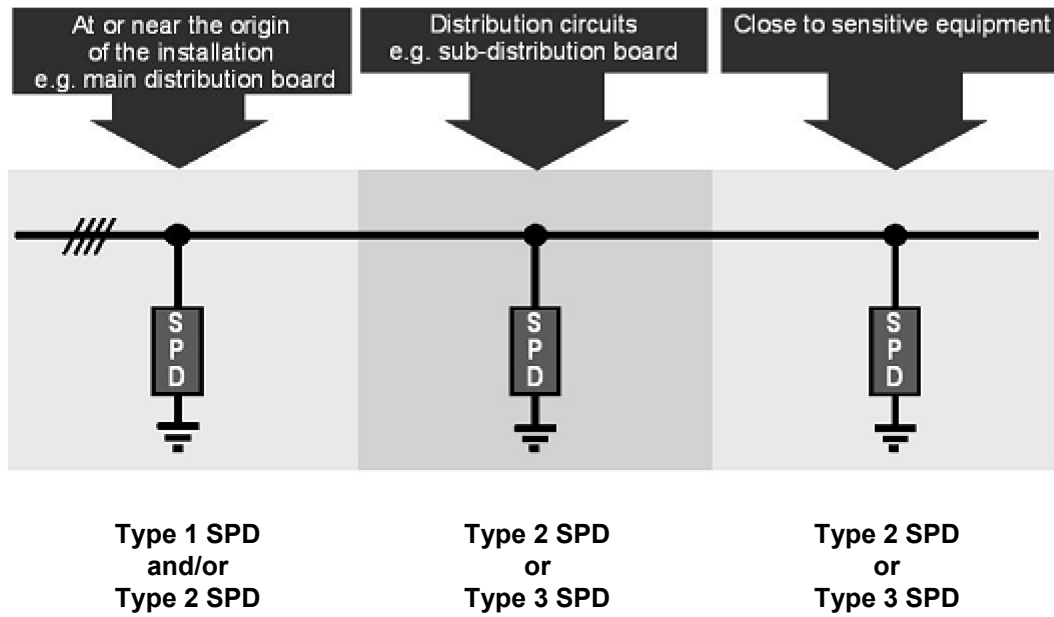


Figure 534.1 — Example of installation of Type 1, Type 2 and Type 3 SPDs

