

<b>STN</b>	<b>Nízkonapäťové poistky Časť 3: Doplnkové požiadavky na poistky používané nekvalifikovanou obsluhou (poistky prevažne na domové a podobné použitie) Príklady normalizovaných systémov poistiek A až F Oprava AC</b>	<b>STN EN IEC 60269-3/AC</b>  35 4701
------------	--	---

Low-voltage fuses - Part 3: Supplementary requirements for fuses for operation by unskilled persons (fuses mainly for household and similar applications) - Examples of standardized systems of fuses A to F

Táto norma obsahuje anglickú verziu európskej normy.  
This standard includes the English version of the European Standard.

Táto norma bola oznámená vo Vestníku ÚNMS SR č. 03/26

Obsahuje: EN IEC 60269-3:2025/AC:2025, IEC 60269-3:2024/COR1:2025

**142083**

---

Úrad pre normalizáciu, metrológiu a skúšobníctvo Slovenskej republiky, 2026  
Slovenská technická norma a technická normalizačná informácia je chránená zákonom č. 60/2018 Z. z. o technickej normalizácii v znení neskorších predpisov.

EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

**EN IEC 60269-  
3:2025/AC:2025-12**

December 2025

---

ICS 29.120.50

English Version

**Low-voltage fuses - Part 3: Supplementary requirements for  
fuses for operation by unskilled persons (fuses mainly for  
household and similar applications) - Examples of standardized  
systems of fuses A to F  
(IEC 60269-3:2024/COR1:2025)**

Fusibles basse tension - Partie 3: Exigences  
supplémentaires pour les fusibles destinés à être utilisés  
par des personnes non qualifiées (fusibles pour usages  
essentiellement domestiques et analogues) - Exemples de  
systèmes de fusibles normalisés A à F  
(IEC 60269-3:2024/COR1:2025)

Niederspannungssicherungen - Teil 3: Ergänzende  
Anforderungen an Sicherungen zur Betätigung durch Laien  
(Sicherungen vorwiegend für den Hausgebrauch und  
ähnliche Anwendungen) - Beispiele für genormte  
Sicherungssysteme A bis F  
(IEC 60269-3:2024/COR1:2025)

This corrigendum becomes effective on 5 December 2025 for incorporation in the English language version of the EN.



European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels**

### **Endorsement notice**

The text of the corrigendum IEC 60269-3:2024/COR1:2025 was approved by CENELEC as EN IEC 60269-3:2025/AC:2025-12 without any modification.

IEC 60269-3:2024/COR1:2025 © IEC 2025

INTERNATIONAL ELECTROTECHNICAL COMMISSION  
COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

**IEC 60269-3**  
Edition 5.0 2024-08

Low-voltage fuses -  
Part 3: Supplementary requirements for fuses  
for operation by unskilled persons (fuses  
mainly for household and similar applications) -  
Examples of standardized systems of fuses A  
to F

**IEC 60269-3**  
Édition 5.0 2024-08

Fusibles basse tension -  
Partie 3: Exigences supplémentaires pour les  
fusibles destinés à être utilisés par des  
personnes non qualifiées (fusibles pour  
usages essentiellement domestiques et  
analogues) - Exemples de systèmes de  
fusibles normalisés A à F

### CORRIGENDUM 1


Corrections to the French version appear after the English text.

Les corrections à la version française sont données après le texte anglais.

**Figure 110 – Fuse-link, D-type, Sizes D01-D03**

Replace existing Figure 110 with the following new figure:

Dimensions in millimetres

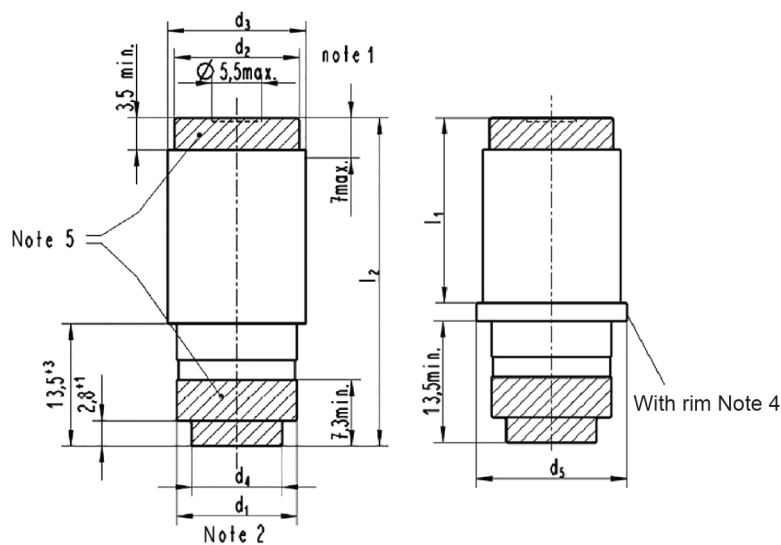

IEC

## IEC 60269-3:2024/COR1:2025 © IEC 2025

	$I_n$	$d_1$ (note 2) $\pm 0,3$	$d_2$ (min.)	$d_3$	$d_4$ (max.)	$d_5$ (note 4)	$I_1$ (note 4)	$I_2 \pm 1$	$r$ (max.)
	A	mm	mm	mm	mm	mm	mm	mm	mm
D01	2	7,3							
	4	7,3							
	6	7,3							
	10	8,5	9,8	$11 \begin{smallmatrix} 0 \\ -0,7 \end{smallmatrix}$	6	–	–	36	1
	13	8,5							
	16	9,7							
D02	20	10,9				16,7 (max)			
	25	12,1				16,7 (max)			
	32	13,3				16,7 (max)			
	35	13,3	13,8	$15,3 \begin{smallmatrix} 0 \\ -0,8 \end{smallmatrix}$	10	16,7 (max)	18,5	36	1
	40	13,3				16,7 (max)			
	50 (note 4)	14,5				$16,7 \begin{smallmatrix} 0 \\ -1,3 \end{smallmatrix}$			
	63	15,9				16,7 (max)			
D03	80 (note 4)	22	20,6	$22,5 \begin{smallmatrix} 0 \\ -1 \end{smallmatrix}$	18	$25,6 \begin{smallmatrix} 0 \\ -2,3 \end{smallmatrix}$	22,5	43	1,6
	100	25				25,6 (max)			

NOTE 1 Diameter of fuse-indicator.

NOTE 2 The maximum value of  $d_1$  shall not be exceeded within a range of 13,5 mm.

NOTE 4 Choice of manufacturer, obligatory for 50 A and 80 A. The rim is necessary for the 50 A and 80 A rating to ensure correct insertion. The rim may be used for other ratings in sizes D02 and D03.

NOTE 5 Hatched areas specify contact areas.


Body of the fuse-link of ceramic material.

NOTE 6 The sketches are not intended to govern the design except as regards the dimensions shown.

IEC 60269-3:2024/COR1:2025 © IEC 2025

**Figure 111 – Fuse-link, D-type, Sizes DII-DIV**

Replace existing Figure 111 with the following new figure:

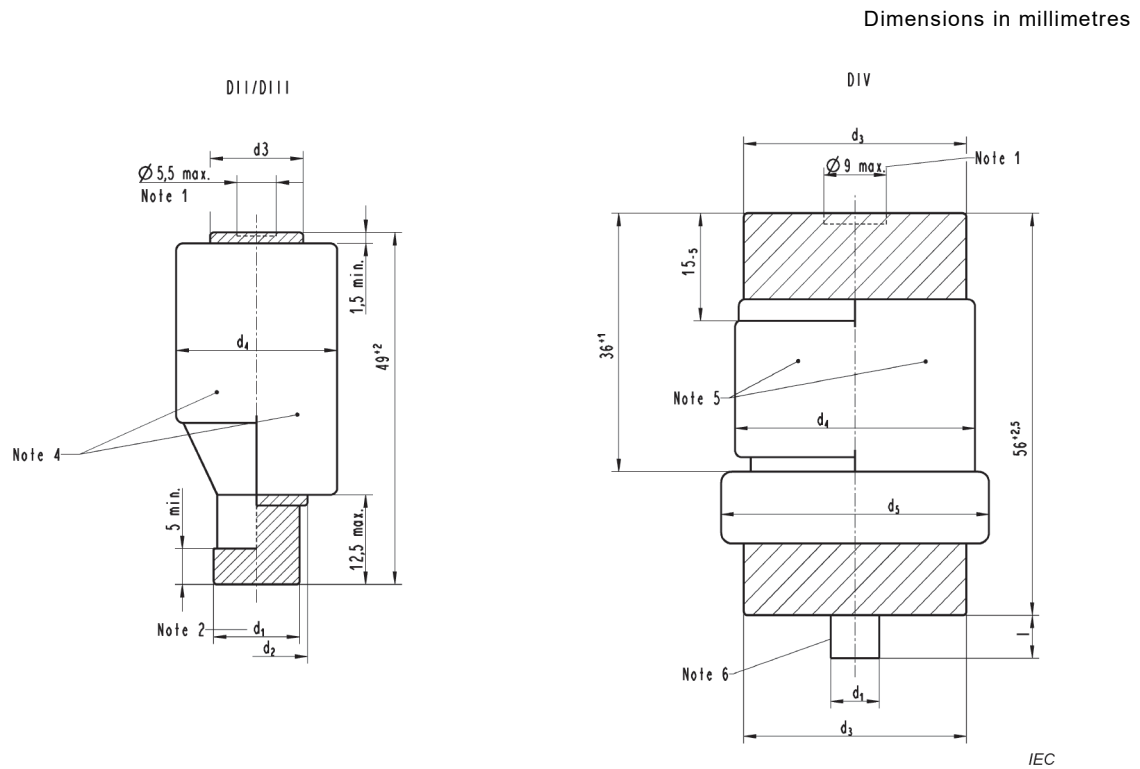

The sketches are not intended to govern the design except as regards the dimensions shown.

Hatched areas specify contact areas.

Body of the fuse-link of ceramic material.

	$I_n$	$d_1$ (note 2)	$d_2$ (max.)	$d_3$	$d_4$	$d_5$ $\begin{matrix} 0 \\ -2 \end{matrix}$	$I$ $\pm 0,3$
	A	mm	mm	mm	mm	mm	mm
DII	2	6	$\begin{matrix} +0,2 \\ -0,4 \end{matrix}$	14,2	11 min	$22,5 \begin{matrix} 0 \\ -1,5 \end{matrix}$	-
	4						
	6						
	10	8			13 min		
	13						
	16	10					
	20	12					
25	14						
DIII	32	16	$\begin{matrix} +0,2 \\ -0,4 \end{matrix}$	20,2	15 min	$28 \begin{matrix} 0 \\ -2 \end{matrix}$	-
	35	16					
	40	16					
	50	18					
	63	20					
DIV	80 (6)	5	$\pm 0,2$	-	$32 \begin{matrix} 0 \\ -8 \end{matrix}$	$34,5 \begin{matrix} 0 \\ -2 \end{matrix}$	38,5
	100	7					

## IEC 60269-3:2024/COR1:2025 © IEC 2025

$I_n$ A	Colour of fuse-indicator
2	Pink
4	Brown
6	Green
10	Red
13	Black
16	Grey
20	Blue
25	Yellow
32	Violet
35	Black
40	Green
50	White
63	Copper
80	Silver
100	Red

NOTE 1 Diameter of fuse-indicator.

NOTE 2 The maximum value of  $d_1$  shall not be exceeded within a range of 10 mm for fuse-links DII and DIII measured from the bottom contact.

NOTE 3 Alternative shape.

NOTE 4 Optional metal cover.

NOTE 5 The gauge-pin is not mandatory for fuse-links with rated current 80 A.


The use of these colours is mandatory also for sizes D01-D03.

IEC 60269-3:2024/COR1:2025 © IEC 2025


**Figure 121 – Gauge-piece and hand-key, D-type, Sizes D01-D03**

Replace existing Figure 121 with the following new figure:

Dimensions in millimetres

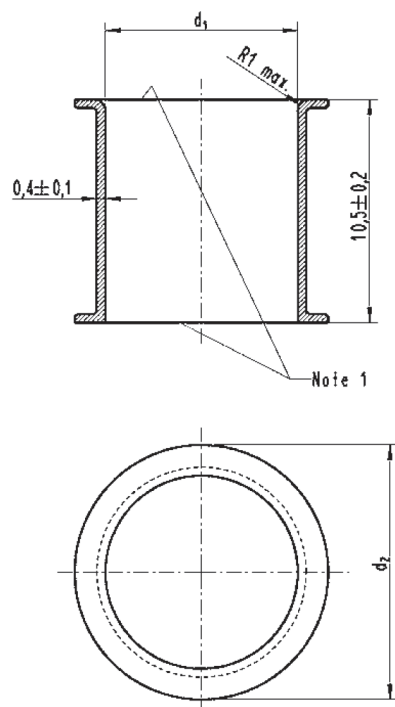

	$I_n$ A	$d_1$ $\pm 0,1$	$d_2$ $\pm 0,1$
D01	2	7,9	12
	4	7,9	
	6	7,9	
	10	9,1	
	13	9,1	
	16	(note 4)	(note 4)
D02	20	11,5	16,6
	25	12,7	
	32	13,9	
	35	13,9	
	40	13,9	
	50	15,1	
	63	(note 4)	(note 4)
D03	80	23	27
	100	(note 4)	(note 4)

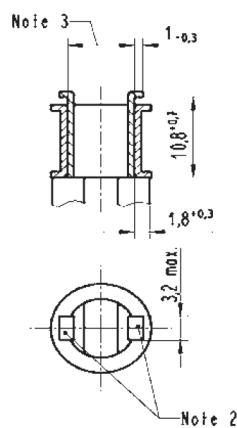

NOTE 1 Coloured according to Figure 111 (table).

NOTE 2 Grip of the working head.

NOTE 3 Resilient between 5 mm and 24 mm.

NOTE 4 Gauge-pieces do not apply to the maximum rating.

IEC


The sketches are not intended to govern design except as regards the dimensions shown.

IEC 60269-3:2024/COR1:2025 © IEC 2025

**Figure 122 – Gauge-piece and hand-key, D-type, Sizes DII-DIV**


Replace existing Figure 122 by the following new figure:

Dimensions in millimetres

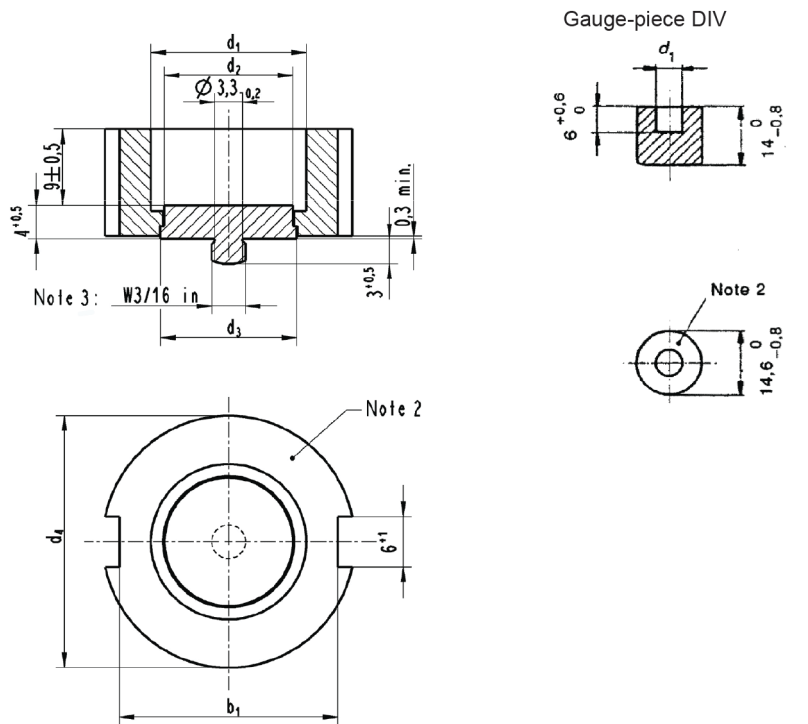

IEC

Insulating part of ceramic material

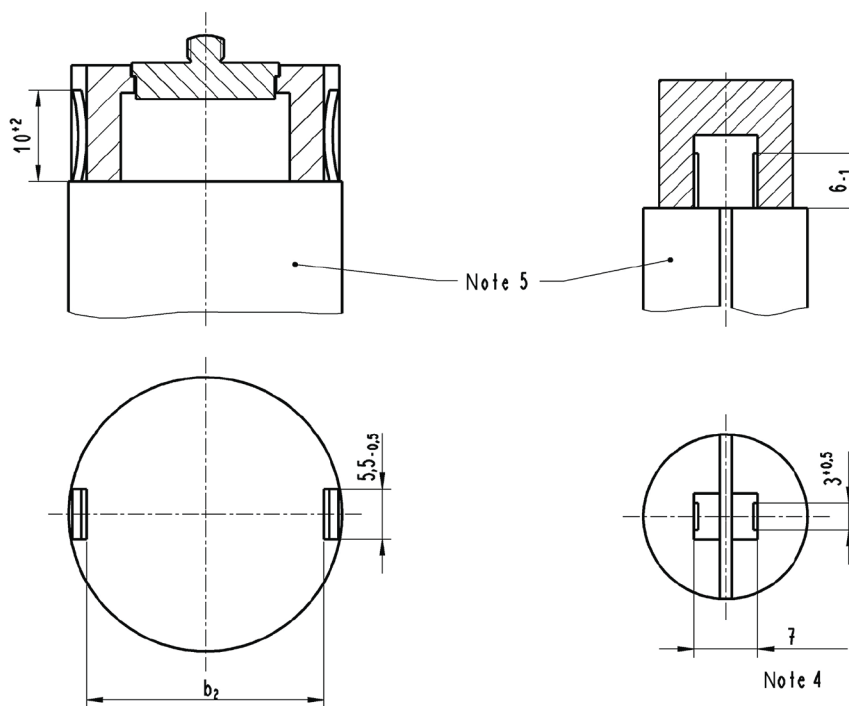

IEC

## IEC 60269-3:2024/COR1:2025 © IEC 2025

The sketches are not intended to govern design except as regards the dimensions shown.

	$I_n$ A	$d_1$ mm		$d_2$ (min.) mm	$d_3$ (min.) mm	$d_4$ mm	$b_1$ (min.) mm	$b_2$ (max.) mm
						0 -1,5	0 -1,5	
DII	2	6,5	+0,8 0	4,5	6,5	24	20	19 (note 6)
	4	6,5						
	6	6,5						
	10	8,5		6,5				
	13	8,5						
	16	10,5		8,5				
	20	12,5		9,5	9,5			
25	14,5							
DIII	32	16,5	+0,8 0	15	15	30	26	25 (note 7)
	35							
	40							
	50	18,5	15	15	30			
63	20,5							
DIV	80	6	±0,5	–	–	–	–	–
	100	8		–	–	–	–	–

NOTE 1 void

NOTE 2 Coloured according to Figure 111 (table).

NOTE 3 Effective thread length at least 2,5 mm.

NOTE 4 Resilient between 5 mm and 9 mm.

NOTE 5 Insulating material.

NOTE 6 Resilient between 18 mm and 20,5 mm.



NOTE 7 Resilient between 24 mm and 26,5 mm.

IEC 60269-3:2024/COR1:2025 © IEC 2025

**Figure 123 – Gauge-piece and hand-key, D-type push-in gauge rings, Size DII-DIII**

Replace existing Figure 123 with the following new figure:

Dimensions in millimetres

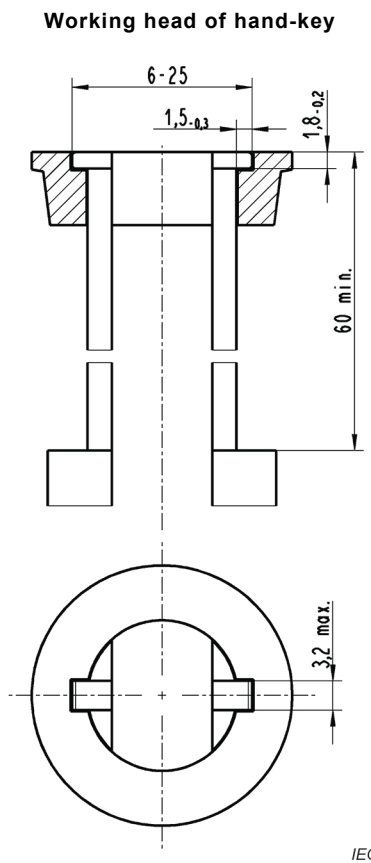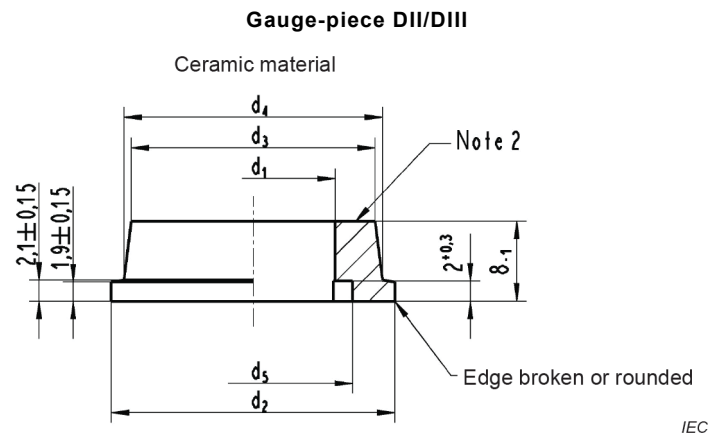

## IEC 60269-3:2024/COR1:2025 © IEC 2025

The sketches are not intended to govern design except as regards the dimensions shown.

	$I_n$	$d_1$ <b>+0,8</b> mm	$d_2$ <b>±0,5</b> mm	$d_3$ <b>±0,5</b> mm	$d_4$ <b>±0,5</b> mm	$d_5$ (min.) mm	Colour of the front surface
	A						
DII	2	6,5	22,5	18,5	20,5	10	Pink
	4						Brown
	6						Green
	10	8,5				12	Red
	16	10,5				14	Grey
	20	12,5				15,5	Blue
	25	(see Note 3)					
DIII	2	6,5	28,5	24,5	26,5	10	Pink
	4						Brown
	6						Green
	10	8,5				12	Red
	16	10,5				14	Grey
	20	12,5				16	Blue
	25	14,5				18	Yellow
	32	16,5				20	Violet
	35	16,5				20	Black
	40	16,5				20	Green
	50	18,5				21,5	White
	63	(see Note 3)					

NOTE 1 void

NOTE 2 Coloured surface.

NOTE 3 Gauge-pieces do not apply to the maximum ratings.